FIRE PURPOSES ONLY

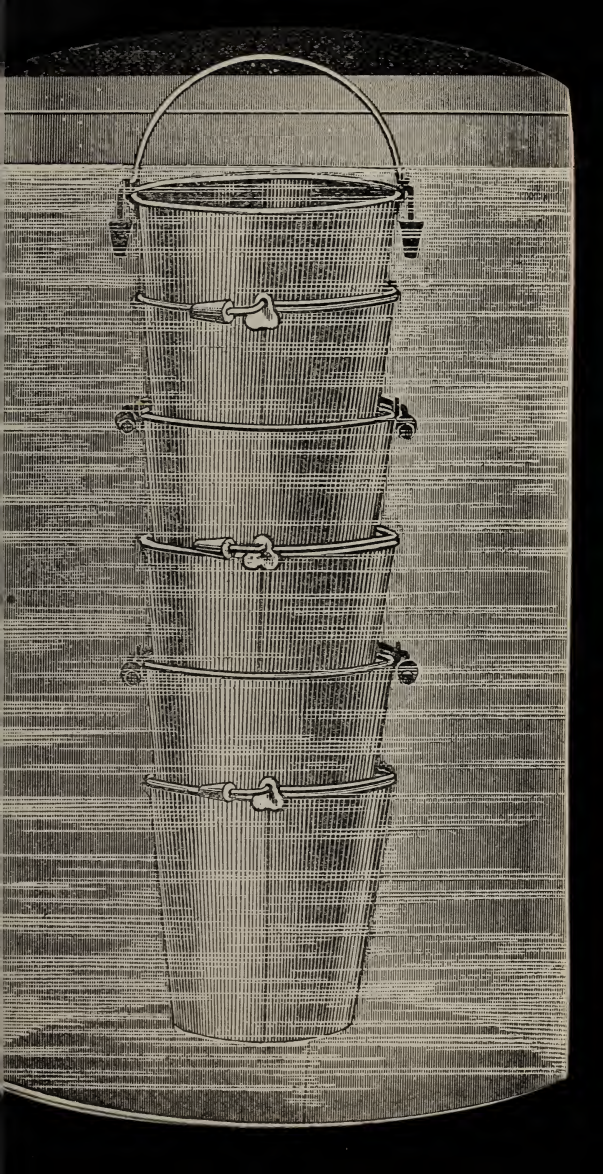

DESCRIPTION.

The Safety Fire Bucket Tank and Buckets are made of heavy Galvanized Iron, and are lined to prevent rust.

The tanks are japanned red on the outside, and have a hinge cover which closes down on a rubber packing, so as to make the tank air-tight, thus preventing evaporation.

The handles of the buckets are weighted so that when the top bucket is removed, *the handle of the next rises automatically.*

Each bucket has two lugs on the outside of each pail so that when the buckets are placed in the tank, one inside of the other, they rest on the lugs, and consequently cannot bind or stick.

Every tank is accompanied by a bag of dry compound in powder form, with full directions for using. This powder, dissolved in water, forms a chemical solution with which the tank is filled. The solution, in contact with flame, forms a gas which has a fire-destroying capacity equal to many times the same quantity of water.

Where the tanks are to be used in exposed places, we furnish a compound that will not freeze in zero weather. The solution contains no acid, and is harmless; it does not lose its efficiency with age.

When the six buckets have been removed, there is enough solution left in the tank to refill four of the buckets.

The tank, being ornamental, can be put in a conspicuous place, where it will be sure to be seen and used in case of fire. Fire-pails are unsightly, take up much space, and need refilling frequently, and are usually found wanting at the critical moment. Even then the water in them becomes stagnant and foul-smelling, and is liable to be used for other purposes.

We have received many endorsements from Insurance Companies, Fire Underwriters, and others.

Will you not look into the merits of this appliance with a view of using them in your building?

The Safety Fire Extinguisher Co.,

SPAULDING BUILDING,

29-31-33 West 42d St., - New York.

These concerns are using the Safety Fire Bucket Tank:

Stern Bros	New York
B. Altman & Co	"
J. A. Hearn & Son	"
Pennsylvania Railroad	"
Mills & Gibbs	"
Lesher, Whitman & Co	"
N. J. & Hudson River Ry & F'y Co.	"
Fleitmann & Co	"
American Flag Co	"
Loeb & Schoenfeld	"
L. J. Callahan	"
Richard Webber	"
Schmidt & Schwanenfleugel	"
Bernheimer & Schmidt	"
Lincoln Safe Deposit Co	"
West Shore Railroad	"
A. J. Cammeyer	"
Geo. C. Flint & Co	"
R. J. Horner & Co	"
C. C. Shayne	"
Evening Post Building	"
R. Dunlop & Co	"
Sicilian Asphalt Paving Co	"
B. Fisher & Co	"

American Ice Co.....New York
Siegel, Cooper & Co..... "
W. & J. Sloane ..... "
Baker & Williams..... "
Driggs Storage Warehouse..... "
Staten Island Ferry Co..... "
Manhattan Refrigerating Co..... "
Arnold, Constable & Co..... "
John Wanamaker..... "
The Aeolian Co..... "
Department of Docks & Ferries.... "
Columbia Storage Warehouse..... "
Adams Dry Goods Co.....New York City.
Rothenberg & Co..... "
Quintard Iron Works..... "
International Navigation Co... "
United States Leather Co..... "
C. M. Higgins & Co.....Brooklyn
Germania Savings Bank Bldg..... "
W. B. A. Jurgens..... "
Otis Elevator Co.....Yonkers, N. Y.
Merrell-Soule Co.....Syracuse, N. Y.
Sibley, Lindsay & Curr.....Rochester, N. Y.
Hotel Ten Eyck.....Albany, N. Y.
Rathbone, Sard & Co.....Albany, N. Y.
United Shirt & Collar Co.....Troy, N. Y.
Hudson River Wood Pulp & Paper
Co.....Brown Station, N. Y.
Union Bag & Paper Co...Ballston Spa, N. Y.
Winters & Prophet.....Mount Morris, N. Y.
Union Stock Yard & Transit Co.....Chicago
American Type Founders' Co..... "
J. V. Farwell Co..... "
Montgomery Ward & Co..... "
Morgan & Wright..... "
Miehle Printing Co..... "
Searle & Hereth..... "
Mandel Bros..... "
Link-Belt Machinery Co..... "

Art Wall Paper Mills..... Chicago
The Coliseum..... "
Walsh, Lange & Co..... "
McCormick Harvesting Machine Co... "
Western Electric Co..... "
David C. Cook & Co.....Elgin, Ill.
T. T. Bent & Sons.....Oglesby, Ill.
Satterly Mfg. Co.....Springfield, Ill.
Barnard & Lea Mfg. Co.....Moline, Ill.
Litt Bros.....Philadelphia, Pa.
John B. Stetson & Co..... " "
Strawbridge & Clothier..... " "
Geo. Watkinson & Co..... " "
C. F. Rumpp & Sons..... " "
Mellor & Rittenhouse Co..... " "
Bement Miles & Co.....Philadelphia, Pa.
Thomas C. Jenkins.....Pittsburg, Pa.
Kaufmann Brothers ..... " "
Joseph Horne & Co.....Pittsburg, Pa.
Solomon & Ruben..... " "
Lycoming Pants Co.....Williamsport, Pa.
Lehigh Coal & Navigation Co....Lansford, Pa.
Mill Creek Coal Co.....New Boston, Pa.
R. & H. Simon.....Easton Pa.
Del. River Iron Ship Bldg. Works. " "
Lackawanna Lumber Co.....Cross Forks, Pa.
Keystone Store Co.....Scranton, Pa.
La Belle Cutlery Co.....Allegheny, Pa.
Westmoreland Coal Co.....Irwin, Pa.
G. B. Markle & Co.....Jeddo, Pa.
Danville Bessemer Co.....Danville, Pa.
American Sheet Steel Works....Scottdale, Pa.
Emporium & Golden Rule Bazaar,
San Francisco, Cal.
Pioneer Box Co.....Sacramento, Cal.
Weinstock, Lubin & Co..... " "
F. W. Braun & Co.....Los Angeles, Cal.
Mason-Hamlin Co. .....Cambridge, Mass.
Worcester Corset Co.....Worcester, Mass.

R. H. White & Co.....Boston, Mass.
Waldo Bros. ..... " "
Atlas Stores ..... " "
Jordan, Marsh & Co..... " "
Forbes & Wallace.....Springfield, Mass.
Dartmouth Mills .....New Bedford, Mass.
Plymouth Clothing House..Minneapolis, Minn.
Minneapolis Central City Market Co.,
Minneapolis, Minn.
S. E. Olsen & Co.....Minneapolis, Minn.
Birkhofer Brewing Co..... " "
New England Furniture Co. " "
Gleuks Brewery.....Minneapolis, Minn.
Washburn-Crosby Flour Mill Co.,
Minneapolis, Minn.
Pillsbury Flour Mill Co..... " "
Silver Spring B. & D. Co....Providence, R. I.
Crown Worsted Mills..... " "
Pycott Mfg. Co.....Woonsocket, R. I.
New England Steam Brick Co.,
Barrington, R. I.
Burgess & Ross.....Cleveland, O.
Globe & Wernicke Co.....Cincinnati, O.
Harkness & Cowing Co.....Cincinnati, Ohio.
Beaver Soap Co.....Dayton, O.
W. H. Hoover .....New Berlin, O.
American Envelope Co...West Carrollton, O.
E. B. Warren & Co.....Washington, D. C.
Guy Curran & Co..... " "
House & Hermann..... " "
Franco-American Food Co...Jersey City, N. J.
West Bergen Steel Works.. " " "
Hahne & Co.....Newark, N. J.
Lambert Hoisting Engine Co... " "
Woodbury Mfg. Co.....Baltimore, Md.
Maryland Pavement Co..... " "
Mansur & Tibbets Implement Co.,
St. Louis, Mo.
American Tobacco Co..... " "

Jacob Dold Packing Co.....Kansas City, Mo.
Hamilton Carhart & Co.....Detroit, Mich.
Ireland & Matthews Co.....Detroit, Mich.
W. B. Mershon & Co.....Saginaw, Mich.
Jackson Grocery Co.....Jackson, Mich.
Utah Sugar Co.....Lehi, Utah.
Zion Co-operative Mercantile Institution,
Salt Lake City, Utah.
John Scowcroft & Sons Co.....Ogden, Utah.
Butelle Bros. Co.....Dubuque, Iowa.
Younker Bros.....Des Moines, Ia.
Morrison Mfg. Co.....Fort Madison, Ia.
Gem Garment Co.....Indianapolis, Ind.
Bemis Omaha Bag Co.....Omaha, Neb.
Paxton & Gallagher Co..... " "
Pabst Brewing Co.....Milwaukee, Wis.
Fox River Paper Co.....Appleton, Wis.
Dudley Lumber Co.....Granite Falls, N. C.
Tyson & Jones Buggy Co.....Carthage, N. C.
Stimson & Steele.....Turnersburg, N. C.
D. H. Holmes .....New Orleans, La.
Waterbury Clock Co.....Waterbury, Conn.
Burns Silver Co.....Bridgeport, Conn.
Harlin & Hollingsworth Co..Wilmington, Del.
Northern Maine Packing Co.....Corinna, Me.
Sweetwater Woolen Mills..Sweetwater, Tenn.
Willamette Iron & Steel Co....Portland, Ore.
Moran Bros. Co.....Seattle, Wash.
Weidemann Brewing Co.....Newport, Ky.
Kohn, Fuchgot & Co.....Jacksonville, Fla.
National Tube Co.....Wheeling, W. Va.
Cripple Creek Sampling & Ore
Works.....Cripple Creek, Col.
Canadian Rubber Co.....Montreal, Can.
Montreal Pipe Foundry Co.... " "
Dominion Bridge Co..... " "

What those who have used the Safety Fire Bucket Tank say:

THE EVENING POST JOB PRINTING OFFICE,

Broadway, Corner Fulton Street.

The Safety Fire Extinguisher Co.,
New York City.

New York, June 28, 1900.

Gentlemen:—Replying to yours of the 27th, we have examined the eight No. 1 Safety Fire Bucket Tanks which we purchased in 1894, and find them in good condition, and we are well satisfied with them.

Yours truly,
THE EVENING POST JOB PRINTING OFFICE,
John Nolty, Manager.

NEW YORK FIRE INSURANCE EXCHANGE,

32 Nassau St..
Henry E. Hess, Manager.

New York, April 24, 1901.

The Safety Fire Extinguisher Co.,
29-33 West 42d St., City.

Gentlemen:—Replying to yours of April 23d, it is our practice to accept your Safety Fire Bucket Tanks in lieu of an equal number of

filled fire pails, and to allow therefor the same rebate.

Very truly yours,
H. E. Hess,
Manager.

BAKER & WILLIAMS,

Bonded and Free Warehouses.
Office 274 Water St.

New York, June 26, 1900.

Safety Fire Extinguisher Co.,
29 West 42d St., City.

Dear Sirs:—In reply to your letter of the 25th would say that we have examined your Safety Fire Bucket Tanks a number of times during the five years they have been in our possession and are willing to state that the liquid has never been frozen or become foul and that they are perfectly satisfactory to us.

Very truly yours,
Baker & Williams.

LYCOMING PANTS COMPANY,

Manufacturers of Pantaloons.

Williamsport, Pa., Dec. 18, 1900.

The Safety Fire Extinguisher Co.,
New York, N. Y.

Gentlemen:—Through the valuable service of your Safety Fire Bucket Tank, what would no doubt have proved a very serious fire was averted in our factory this morning. After carefully going over our factory we find in order to protect ourselves we shall require eight (8) more Safety Fire Bucket Tanks.

Please forward same immediately and charge your very lowest price and best discount. We shall require many more soon as our new

factory which we are now erecting is completed.

Very truly yours,
LYCOMING PANTS COMPANY.

BEMIS OMAHA BAG COMPANY,

Burlap Importers & Bag Manufacturers.

Omaha, Neb., Dec. 20, 1899.

The Safety Fire Extinguisher Co.,
New York, N. Y.

Gentlemen:—We made a practical test this morning of your Safety Fire Bucket Tanks and were quite satisfied with the results.

Yours truly,
BEMIS OMAHA BAG COMPANY.
M. C. Peters, Manager.

R. A. McWHIRR COMPANY,

Dry Goods, Millinery, Cloaks, Etc.

Fall River, Mass., Feb. 13, 1900.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y.

Gentlemen:—We desire that you ship us ten (10) of your Safety Fire Bucket Tanks same size as those formerly furnished us, price as before, as per your letter. We have recently enlarged our plant, and require these additional Tanks. We have had on three different occasions opportunities to test the utility of these fire Tanks, and on each occasion found them to be just what we required. On each occasion it was demonstrated to us the absolute necessity of having the Tanks distributed throughout our establishment.

Yours truly,
R. A. McWHIRR COMPANY.

HOUSE & HERRMANN,

Furniture, Carpets, Draperies, Etc.
Washington, D. C.

The Safety Fire Extinguisher Co.,
New York City.

Dear Sirs:—Enclosed please find order for ten (10) No. 1 Safety Fire Bucket Tanks and three extra charges. We had occasion to use three of the six we have here with most gratifying results, and the fact of ordering the above is proof of our appreciation of their value.

House & Herrmann.

THE HUB,

Jackson Blvd. & State St.
Dry Goods, Etc.

Chicago, Aug. 31, 1900.

The Safety Fire Extinguisher Co.,
29 West 42d St., New York City.

Gentlemen:—Replying to your letter, we wish to say that we have a number of your Safety Fire Bucket Tanks in our building and have had cause to use them on two or three occasions, when they gave us entire satisfaction, and being of so simple construction, any one can use them.

Yours truly,
Dave Wolfe,
Supt. The Hub.

MINNEAPOLIS DRY GOODS CO.,

501-507 Nicollet Ave.

Minneapolis, Minn., 9-3-1898.

The Safety Fire Extinguisher Co.,
29-33 West 42d St., New York, N. Y.

Gentlemen:—We are pleased to add our testimony to the value of the Safety Fire Bucket Tank. We have used these Tanks for the past five years. They have paid for

themselves several times over in the amount of insurance that they have saved for us. The fact that we continue to use them is the best proof we can give you that we believe that they are all that they are recommended to be.

Yours respectfully,

J. R. Gordon,
Treasurer.

---

54 Franklin St.,
New York, October 4th, 1895.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—I kept two of your Safety Fire Bucket Tanks in an unoccupied detached frame building on Long Island throughout the winter of 1894-1895, and always found their contents quite liquid even in the coldest weather.

Yours truly,

John R. Waters.

LINCOLN SAFE DEPOSIT COMPANY,

32-34 East 42d St.
New York, May 6th, 1896.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—We would state that the Safety Fire Bucket Tanks furnished by you in June and January, 1894, twenty-one in all, are in good condition.

We have had no occasion to use them, but we believe them to be in every way superior to anything in the way of fire extinguishers, combining, as they do, economy of space and simplicity of usage.

Yours truly,

Walter C. Reid,
Warehouse Supt.

BURGESS & ROSS,

Wholesale Grocers.
198-200-202 Bank Street.
Cleveland, Ohio, Feb. 5th, 1896.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—We are already using a dozen of the Safety Fire Bucket Tanks. I think them the best thing of the kind we ever saw.

Yours truly,
BURGESS & ROSS.

HARPER BROS., PUBLISHERS,

Franklin Sq.
New York, Sept. 10th, 1895.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—September 3d we filled a No 2 Safety Fire Bucket Tank with your non-freezing mixture and delivered it to the Brooklyn Bridge Freezing Co. With this find the report of the Freezing Co. I examined the tank to-day and found no ice in it.

Yours truly,
E. DESHAYES, Engineer.

BROOKLYN BRIDGE FREEZING CO.,

Franklin Sq.
New York, Sept. 10th, 1895.

Messrs. Harper Bros., New York.

Gentlemen:—On Sept. 3d we received a can of liquid which you sent us, and placed it in a temperature ranging from 2 degrees to 8 degrees below zero, Fahrenheit.

It has remained there one week and we see no signs of ice, the liquid being in the same condition as received.

Yours truly,
H. A. HUMPHREYS, Supt.

H. E. FLETCHER & CO.,

Dealers in Granite & Stone Contractors.

West Chelmsford, Mass., Nov. 30, 1900.

Safety Fire Extinguisher Co.,
New York City.

Dear Sirs:—We recently had a small fire in an adjacent building and the liquid worked to perfection.

Very truly yours,
H. E. FLETCHER.

EMPIRE HOTEL,

Grand Boulevard and 63d St.

New York, May 4th, 1895.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—Please send us charges for the two Tanks you placed in our basement. At a recent fire in one of our apartments your Tanks rendered very satisfactory service.

Yours truly,
W. JOHNSON QUINN.

INTERIOR CONDUIT & INSULATION CO.,

Edward H. Johnson, Pres.
527 West 34th St.

New York, Aug. 13th, 1895.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—Will you please send us by express to Greenwich, Conn., a new charge for one of our Tanks.

We had occasion to use it the other night with the most gratifying results.

Yours truly,
E. JOHNSON.

LESHER, WHITMAN & CO.,

New York, April 23d, 1899.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—We have had eighteen of your Safety Fire Bucket Tanks in our store for the past nineteen months, and we wish to say that we are more than pleased with them, and believe them to be the best means yet devised for the purpose intended.

We should be sorry to be compelled to use the old system of numerous pails of water scattered about our store, troublesome to keep filled, often in the way, and likely to be out of place in time of need.

We are yours truly,
LESHER, WHITMAN & Co.

BOSTON STORE,

Denholm & McKay Co.
Worcester, Mass., Sept. 11th, 1895.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—In reply to your favor of the 10th we beg to state that we have a number of your Safety Fire Bucket Tanks in our store, and we think very highly of them.

Very truly,
DENHOLM & McKAY Co.

New York, March 1st, 1894.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—Please send me three No. 2 Safety Fire Bucket Tanks, same as the ones delivered January 20th.

I consider this the best thing I have seen

and a great improvement on water buckets. I remain,

Yours truly,

GEO. LEGG.

April 22d, 1899.

I am still of the opinion that the Bucket Tanks are a great improvement over the old style of having pails.

Yours truly,

GEO. LEGG.

OFFICE OF WARREN-SCHARF ASPHALT PAVING CO.,

132d St., near 12th Ave.

New York, Oct. 24, 1895.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—Kindly send us at once another of your Safety Fire Bucket Tanks No. 2, together with enough powder to replenish the Tank already in use.

We take pleasure in informing you that your device saved us from a serious fire this afternoon when one of our tar tanks boiled over. A half a dozen pailfuls completely quenched the flames.

Yours truly,
WARREN-SCHARF ASPHALT CO.

SILAS W. DRIGGS WAREHOUSES,

(Bonded and Free).

Offices 278 South St., and 72 Beaver St.

New York, April 17th, 1896.

The Safety Fire Extinguisher Co.,
New York.

Gentlemen:—Your Safety Fire Bucket Tanks have given entire satisfaction, and I have

saved very much trouble and expense. Just the article for warehouses.

Yours respectfully,
SILAS W. DRIGGS.

THE SICILIAN ASPHALT PAVING CO.

Times Building.
New York, May 10th, 1895.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—In response to your request we take pleasure in informing you that we made a practical test last fall of the efficiency of your preparation for extinguishing fires, which convinced us that your material fully answered its purpose.

We have since equipped our factories here, at Alleghany and at Williamsport, Pa., with your Safety Fire Bucket Tanks containing this preparation. Since we purchased the Tanks we have, fortunately, had no fires at any of our plants, but we found that the material did not freeze during last winter, nor has it evaporated since.

Yours truly,
THE SICILIAN ASPHALT CO.,
C. S. Chamberlain, Sec'y.

WM. B. A. JURGENS,

Wholesale Grocer and Commission Merchant.
Brooklyn, May 3d, 1899.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—Referring to the twelve No. 1 Safety Fire Bucket Tanks delivered Feb. 20th, I beg to say they are satisfactory in every respect. As our building is not heated, the tanks have several times been exposed to weather as cold as seven degrees above zero,

without a particle of ice forming.

Yours truly.

W. B. A. JURGENS.

STERN BROS.,

Dry Goods, West 23d St.

New York, April 24th, 1895.

Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—Replying to yours of even date, we beg to say that the Safety Fire Bucket Tanks purchased of you have given and are giving entire satisfaction.

Yours truly,

STERN BROTHERS.

OFFICE OF H. B. GRAVES,

Home Furnishing House.

Rochester, N. Y., Feb. 8th, 1898.

Safety Fire Extinguisher Co., New York.

Gentleman:—A fire started in our warehouse this morning from a broken lantern in bundles of chairs that were wrapped with paper and excelsior. The fire made a very rapid start, but a prompt use of the Safety Fire Bucket extinguished it without the necessity of calling the department. The damage was less than $100.00, and we think that the insurance agent is correct in an opinion that there probably would have been a $3,000 loss if it had been necessary to wait for the fire department.

Please send by express chemical to recharge one No. 2 Tank; also send two new rubber bands for No. 1 Tank.

Yours very truly, H. B. GRAVES.

S. E. OLSON CO.,

Minneapolis, Minn., June 4th, 1896.

The Safety Fire Extinguisher Co., N. Y. City.

Gentlemen:—We have your Safety Fire

Bucket Tanks in use in one of our stores at present and consider them all O. K.

Yours very truly,

S. E. Olson Co.

R. H. WHITE CO.,

Boston.

Boston, Mass., Jan. 26th 1897.

Safety Fire Extinguisher Co., N. Y. City.

Gentlemen:—In reply to your favor of the 26th, we beg to say that we have complied with your request in regard to examining our fire extinguishers and find them to be in perfect condition.

Yours truly,

R. H. White Co.

COWPERTHWAIT & CO.,

Furniture, Carpets, Bedding and General House Furnishings.

104, 106 & 108 West 14th St.

New York, Oct. 27th 1896.

Safety Fire Extinguisher Co.,
New York City.

Dear Sirs:—During a recent fire in our annex we found your extinguishers to be of great service in preventing the spread of the flames. We request you to refill Tanks as soon as possible.

Yours very truly,

Cowperthwait & Co.

BOUTELLE BROS.,

Complete House Furnishers.
Furniture, Stoves and Carpets.

Minneapolis, Minn., November 11th, 1898.

Safety Fire Extinguisher Co.,
New York, N. Y.

Gentlemen:—We have used your Chemical

Fire Extinguisher Tank on a fire we had in our building a few months ago with very satisfactory results.

Yours respectfully,

BOUTELLE BROS

DODSON, FISHER, BROCKMANN CO.

Harness and Saddlery.

Safety Fire Extinguisher Co.,
29 West 42d St., New York.

Gentlemen:—Please send up by express chemical charges to recharge two of the Safety Fire Bucket Tanks purchased from you in 1896. We have a number of the Safety Fire Bucket Tanks and emptied two of them and succeeded in putting out a fire in our basement. Please ship same at once.

Yours truly,

DODSON, FISHER, BROCKMANN CO.

C. C. SHAYNE,

Importer and Manufacturer of Furs.
124-126 West 42d St.,

New York, June 20, 1899.

Safety Fire Extinguisher Co.,
29 West 42d St., New York City.

Gentlemen:—On June 7th a millinery store in the building adjoining mine took fire and the entire contents were consumed. The fire occurred at noon. The fire brigade in my factory, who had been taught how to use your Safety Fire Bucket Tanks, join with me in testifying to the value of your Safety Bucket Tanks. Every pail of water poured on the fire seemed to have the desired effect. After several pails of water (charged with the chemicals which you use) had been poured on the fire, it was put out, and had it not been that my building was supplied with your Safety Fire Bucket Tanks and my people

taught how to use them, I believe that not only my building, but several others on the block, would have burned down, and it is only fair that you should have the credit to which you are entitled.

Enclosed please find check for amount of your bill received to-day for the chemicals necessary to recharge three of the No. 1 Tanks.

Respectfully yours,
C. C. SHAYNE.

PAXTON & GALLAGHER CO.,

Importers,
Coffee Roasters and Jobbing Grocers.

Omaha, Neb., May 18th, 1899.

Safety Fire Extinguisher Co.,
29 West 42d St., New York.

Gentlemen:—We have your esteemed favor of the 15th inst. enclosing invoice for eight new Tanks for our annex building. We consider these Tanks the best thing of the kind manufactured or in use. Our two main buildings have been equipped with them for several years and during this time we haven't been obliged to supply any water whatever, as there has practically been no evaporation and the non-freezing compound has prevented them freezing in the most severe weather.

Yours very truly,
PAXTON & GALLAGHER CO.

SMITH & SILLS,

Importers, Wholesale Grocers and Flour Dealers.
750 8th Ave. and 247 W. 46th St.

New York, Sept., 1896.

Safety Fire Extinguisher Co.,
New York City.

Dear Sirs:—In relation to your Safety Fire

Bucket Tank which we purchased from you some time since, would say, that we had a slight fire at our place last week, and that but for the timely use of your extinguisher might have been serious.

We can certainly cheerfully recommend it as an excellent means for putting out fires.

Yours very truly,

SMITH & SILLS.

JAMES A. HEARN & SON,

20-30 West 14th St.

New York, Oct. 1st, 1895.

Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—Kindly send us thirty-eight No. 1 Safety Fire Bucket Tanks, same as the forty-two we now have in use.

Yours truly,

JAMES A. HEARN & SON.

NEW YORK STORE,

Pettis Dry Goods Co.

Indianapolis, Ind., Jan. 6th, 1896.

Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—The Fire Bucket Tanks which we purchased of you are perfectly satisfactory. We consider them a good thing.

Very respectfully,

PETTIS DRY GOODS CO.

MART. N. HILT,

The Rentalagent,
2d Floor The Phœnix,
Minneapolis, Minn.

Minneapolis, Minn., Sept., 5th, 1898.

Safety Fire Extinguisher Co.,
29-33 West 42d St., New York City.

Gentlemen:—In regard to your Tanks which we have placed in the Printers' Exchange

Building in this city some three years ago, would say we have had a splendid chance to demonstrate the practical value of the Tank. On Oct. 20th, 1896, the large 36-inch main supplying the city water from the pumping station broke, and from six o'clock in the afternoon until two o'clock the next morning this city was entirely without fire protection. Shortly after six o'clock there was a fire discovered in the Printers' Exchange on the sixth floor by our engineer, who by using ten buckets of the chemical from the Tanks succeeded in holding the fire in check until the fire company could arrive and carry a line of chemical hose from the ground floor to the sixth floor. There was a high wind and had we not had our own protection at the building it could not have been saved and a large conflagration would surely have ensued.

Before buying your Tanks I investigated other safety tanks that were being used on the market and was convinced that yours was the best at the present time.

MART N. HILT.

LIT BROTHERS,

Cor. Market and 8th Sts., Philadelphia, Pa.

January 9th, 1896.

Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Dear Sirs:—Replying to your favor of the 7th inst., would say that the Safety Fire Bucket Tanks purchased from you have so far proven entirely satisfactory.

Yours very truly,

LIT BROTHERS.

H. C. F. KOCH & CO.,

Fancy and Dry Goods, Suits, Etc.,
West 125th St.

New York, Oct. 26th, 1893

Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—We have now placed several of your Safety Fire Bucket Tanks in our building for protection against fire, and find same perfectly satisfactory.

Yours truly,
H. C. F. Koch & Co.

WOODWARD & LOTHROP,

Washington, D. C., Sept. 6th, 1895.

Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—In reply to your letter of the 5th, we are happy to say that we have been supplied with the Safety Fire Bucket Tank for some time.

Yours truly,
Woodward & Lothrop.

SEELEY & CO.,

Fire Insurance and Real Estate,
103-104 Boston Block.

Minneapolis, Minn., Sept. 2d, 1898.

Safety Fire Extinguisher Co.,
New York.

Gentlemen:—In reply to your inquiry relative to the Safety Fire Bucket Tanks, would say that it seems to meet all requirements, and after looking over various extinguishers we are convinced that yours have superior advantages, inasmuch as the buckets are always filled and easy of access. Since ordering the

Extinguishers for the "Boston Block" we have since purchased them for other buildings.

SEELEY & CO.,
Managers of Boston Block.

SYNDICATE TRADING CO.,

Representing

Callender, McAuslan & Troup Co., Providence, R. I.
Adam, Meldrum & Anderson Co., Buffalo, N. Y.
Sibley, Lindsay & Curr, Rochester, N. Y.
Brown, Thomson & Co., Hartford, Conn.
Forbes & Wallace, Springfield, Mass.
Denholm, McKay & Co., Worcester, Mass.
Dives, Pomeroy & Stewart, Reading, Pa.
Minneapolis D. G. Co., Minneapolis, Minn.
Doggett D. G. Co., Kansas City, Mo.
Pettis D. G. C., Indianapolis, Ind.

---

120 Franklin St.
New York, Nov. 20th, 1895.

The Safety Fire Extinguisher Co.,
29 West 42nd St., N. Y. City.

Gentlemen:—Please send us eighteen Safety Fire Bucket Tanks. We hope before the first of January to get all our eleven stores equipped with them, as the stores who already have them believe it is the best thing they have had for hand use in extinguishing fires. It is the only thing we have ever found that is in order under under all conditions without requiring attention.

Yours truly,
A. SWAN BROWN.

ROCHESTER CAR WHEEL WORKS,

Rochester, Jan. 7th, 1896.

The Safety Fire Extinguisher Co.,
29 West 42d St., N. Y. City.

Gentlemen:—Your favor of the 6th inst. relative to the Safety Fire Bucket Tanks we purchased from you two or three years ago at hand and noted.

In reply would say we have always been very glad to have these tanks, in fact, on one occasion found immediate use for the same.

Yours very truly,
ROCHESTER CAR WHEEL WORKS.
C. T. Chapin, Pres.

Salt Lake City, Utah, May 28, 1901.

The Safety Fire Extinguisher Co.

Gentlemen:—It is with great satisfaction that I am able to state to you that these Tanks are in my estimation a perfect success. Yesterday morning I had these Tanks filled and placed in position, and about 1:30 in the afternoon fifteen bales of oakum took fire from a match which was struck by the foot of one of the boys as he was passing the oakum. This oakum immediately took fire and if it were not for these Tanks we should have suffered serious loss, but as it was we were able to put the fire out immediately.

Yours very truly,
THE MINE & SMELTER CO.,
(Signed) Warren C. Bogue.

The Maryland Pavement Co.
Baltimore, June 6, 1901.

Safety Fire Extinguisher Co., New York.

Gentlemen:—Please ship us enough non-freezing material to refill one of our Safety Fire Bucket Tanks. We had occasion to use one of the Tanks and it gave good satisfaction.

Yours truly,
THE MARYLAND PAVEMENT CO.

INDORSEMENTS OF INSURANCE MEN.

UNDERWRITERS AT AMERICAN LLOYDS,

45-49 Cedar St.
New York, Feb. 3d, 1894.

The Safety Fire Extinguisher Co.,
29 West 42nd St., N. Y. City.

Gentlemen:—I have had presented to me for criticism one of the Safety Fire Bucket Tanks made by your company, and I consider it one of the most complete, perfect and reliable devices of this character that I have ever examined. In my judgment it fills a long-felt want, and I seriously hope that property owners generally will adopt this device, as it is unique, compact and reliable.

Yours truly,
GEO A. STANTON.

BOSTON BOARD OF FIRE UNDER-WRITERS,

No. 55 Kilby St.
Boston, April 12, 1901.

The Safety Fire Extinguisher Co.,
31 West 42d St., New York, N. Y.

Gentlemen:—We beg to acknowledge your letter and circular of April 10th, and to say that your Tank has been accepted in place of the automatic fire pails, by this board, for several years.

Yours very respectfully,
F. E. CABOT,
Asst. Sec'y.

MINNEAPOLIS INSPECTION OFFICE,

602-603 Sykes Block.
J. A. Brant, Inspector.

Minneapolis, Minn., March 19th, 1895.

The Safety Fire Extinguisher Co.,
29 West 42nd St., N. Y. City.

Gentlemen:—After a careful examination of your Safety Fire Bucket Tank, we have become convinced of the merits of this appliance.

It is neat and tidy in appearance, being air tight and dust proof make it very desirable in places where the open casks and buckets are often objectionable and unsightly.

We take pleasure in recommending it to all property owners needing a first-class commendable appliance for fire protection.

Yours truly,
MINNEAPOLIS UNDERWRITERS' ASS'N.
J. A. Brant, Mgr. and Inspector.

SOUTH EASTERN TARIFF ASSOCIATION,

Atlanta, Ga.
S. F. Lawton, Inspector.

Richmond, March 18th, 1896.

Mr. W. E. Liptrott, Manager,
The Safety Fire Extinguisher Co.,
New York.

Dear Sir:—Replying to your favor of the 13th inst., in reference to the Safety Fire Bucket Tank would say, one of these Tanks with six buckets in same, all filled with chemical solution, will be accepted as equivalent to one cask and twelve pails. There should be two of these Tanks to each 5,000 square feet of floor area.

Yours truly,
S. F. LAWTON, Inspector.

UNDERWRITERS ASSOCIATION OF NEW YORK STATE,

Syracuse, N. Y., December 17th, 1893.

The Safety Fire Extinguisher Co.,
29 West 42nd St., N. Y. City.

Gentlemen:—Answering your letter of the 14th inst., I would say that this association has voted to accept for fire protection your Safety Fire Bucket Tanks as equivalent to casks and pails, when introduced in conformity with the conditions governing the use of casks and pails.

Yours truly,
W. J. Frederick, Secretary.

TEXAS SURVEY & RATING BUREAU,

Geo. W. Jalonick, Manager.

Dallas, Texas, Nov. 23d, 1895.

The Safety Fire Extinguisher Co.,
29 West 42nd St , N. Y. City.

Gentlemen:—I have your favor of the 18th, advising shipment of a model of your Safety Fire Bucket Tank to us, which came duly to hand to-day.

We shall take pleasure in recommending its use as occasion may arise.

Yours truly,
Geo. W. Jalonick, Manager.

UNDERWRITERS' ASSOCIATION OF CINCINNATI,

Miller Building.

The Safety Fire Extinguisher Co.,

Cincinnati, Ohio, Nov. 9th, 1895.

29 West 42nd St., N. Y. City.

Gentlemen:—We have examined the sample of your Safety Fire Tank and are satisfied that it is a good appliance to have in all buildings as a means of putting out incipient fires.

It is far superior to the ordinary water barrel and buckets, which are now generally used and will commend itself to parties who object to the appearance of water barrels in their premises, and where our schedule will permit we will make the usual allowance for your device and add it to our list of approved fire protection.

Yours truly,

GEO. W. GANO, Sec'y.

THE SYRACUSE UNDERWRITERS,

104 Everson Bldg.
Syracuse, N Y., Aug. 19th, 1893.

The Safety Fire Extinguisher Co.,

Gentlemen:—Replying to yours of the 17th the district committee will approve of the Safety Fire Bucket Tank, and will grant the same rebates as for fire pails, in case the insured decide to put the Tanks in according to our specifications, and also with the understanding that we reserve the privilege of nominating pails instead of Tanks, where we may decide that pails are more practical than the tanks.

Yours truly,

J. S. FREDENRICH, Sec'y.

THE ASSOCIATION OF FIRE UNDERWRITERS.

District of Columbia.
Washington, D. C., Nov. 13th, 1893.

The Safety Fire Extinguisher Co.,
29 West 42nd St., N. Y. City.

Gentlemen:—I am in receipt of your circular describing the Safety Fire Bucket Tank manufactured by the Safety Fire Extinguisher Co.,

of New York, and have had the chemical solution therein tested by the Inspector of the Association of Fire Underwriters of this district.

I consider the device very valuable for preventing the spread of fires, and would recommend its general introduction into any premises subject to fire loss.

Yours truly,

E. M. Waters,

Sec'y, Treas. and Inspector.

ROCHESTER BOARD OF FIRE UNDERWRITERS.

446 Powers Building.

Rochester, N. Y., Dec. 4th, 1893.

The Safety Fire Extinguisher Co.,

29 West 42nd St., N. Y. City.

Gentlemen:—After a careful examination of your Safety Fire Bucket Tanks, we cheerfully recommend same as a simple and efficient fire extinguishing device.

Being practically air tight, thus making it desirable for mills and factories, while its neat and tidy appearance makes it especially desirable for mercantile establishments, hotels and other places where casks and pails are objectionable.

Yours truly,

Wm. B. Levet, Pres.

Toronto Board of Fire Underwriters.

Office, Lancashire Building,

J. A. C. McCuaig, Sec'y-Treas.

Toronto, Ont., Canada, April 11, 1901.

Safety Fire Extinguisher Co., 29-33 West 42d Street, New York, N. Y.

Gentlemen:—Your favor of the 9th inst. received. I have already in several cases approved your Safety Fire Bucket Tank in lieu of casks and pails.

Yours truly,

J. A. C. McCuaig, Secretary.

FOR FIRE PURPOSES ONLY

SAFETY
FIRE BUCKET
TANK